

**Iron Concentration**

**EXPLANATION**



Iron concentration, in mg/L for selected wells

● ≤ 0.3

▲ 0.31—5.0

□ > 5.0

Secondary drinking water standard is 0.3 mg/L

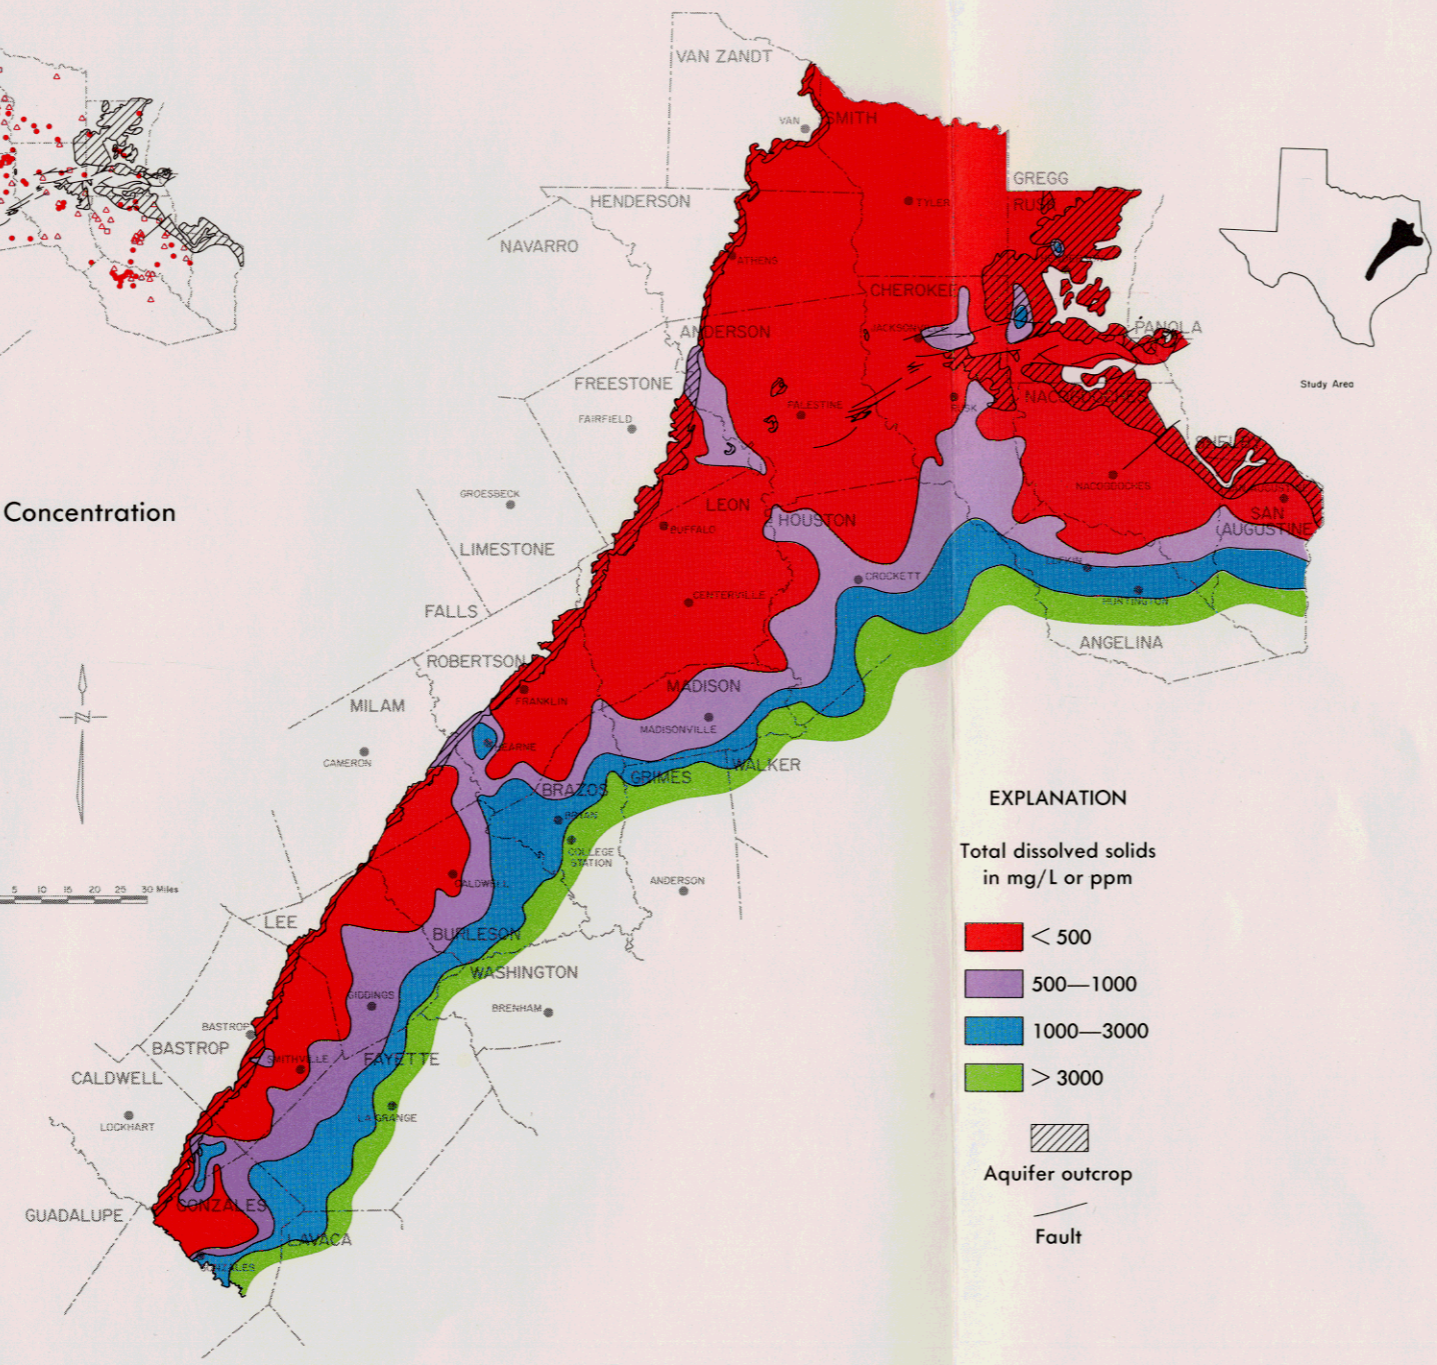

**EXPLANATION**

Total dissolved solids in mg/L or ppm

■ < 500

■ 500—1000

■ 1000—3000

■ > 3000




Aquifer outcrop



Fault


**Sulfate Concentration**

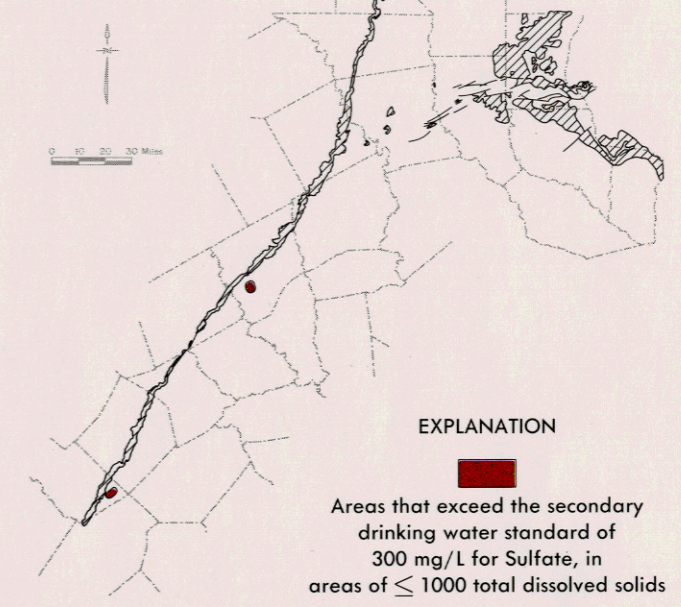

**EXPLANATION**

■ Areas that exceed the secondary drinking water standard of 300 mg/L for Sulfate, in areas of ≤ 1000 total dissolved solids

**Chloride Concentration**

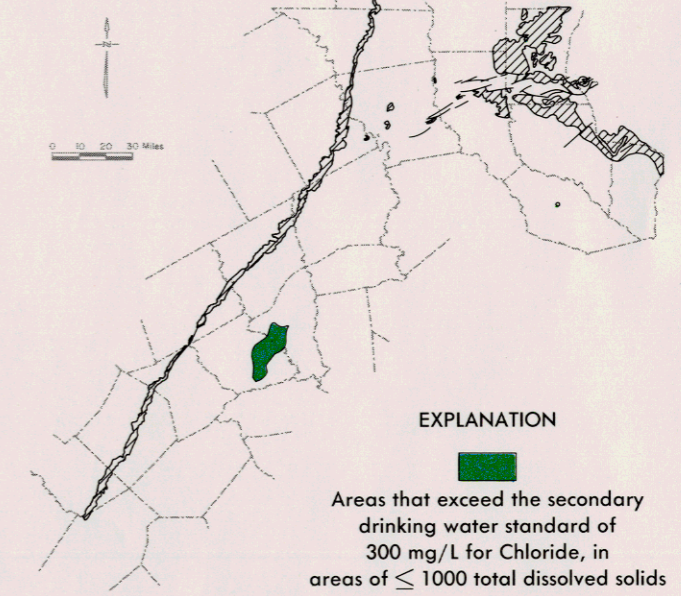

**EXPLANATION**

■ Areas that exceed the secondary drinking water standard of 300 mg/L for Chloride, in areas of ≤ 1000 total dissolved solids

Modified from maps and data contained in a report in progress by:  
Kaiser, W. R., Fogg, G. E., and Ambrose, M. L.

Other sources of data:  
Follett, C. R., 1974; Klemm, W. B., Duffin, G. L., and Elder, G. R., 1976; Thompson, G. L., 1966; and William F. Guyton and Associates, 1972.

**Figure 9B**  
**Existing Ground-Water Quality in the Carrizo-Wilcox Aquifer, Central Area**  
(Based on Total Dissolved Solids Content of Ground Water From Wells Tapping the Carrizo Sand Portion of the Aquifer, With Sulfate, Chloride, and Iron Concentration Insets)